


NOTE TO DETAILER:

FOR COLUMNS WITH DIAMETERS GREATER THAN 4'-0" USE #5 TIES AT @ 3" CTS. AND #5 SPIRAL @ 3" CTS.

TOP MAT OF REINFORCING STEEL IN FOOTING NOT SHOWN FOR CLARITY.

COLUMN CONNECTION DETAILS FOR SEISMIC PERFORMANCE ZONE 2

FIGURE 7 - 29

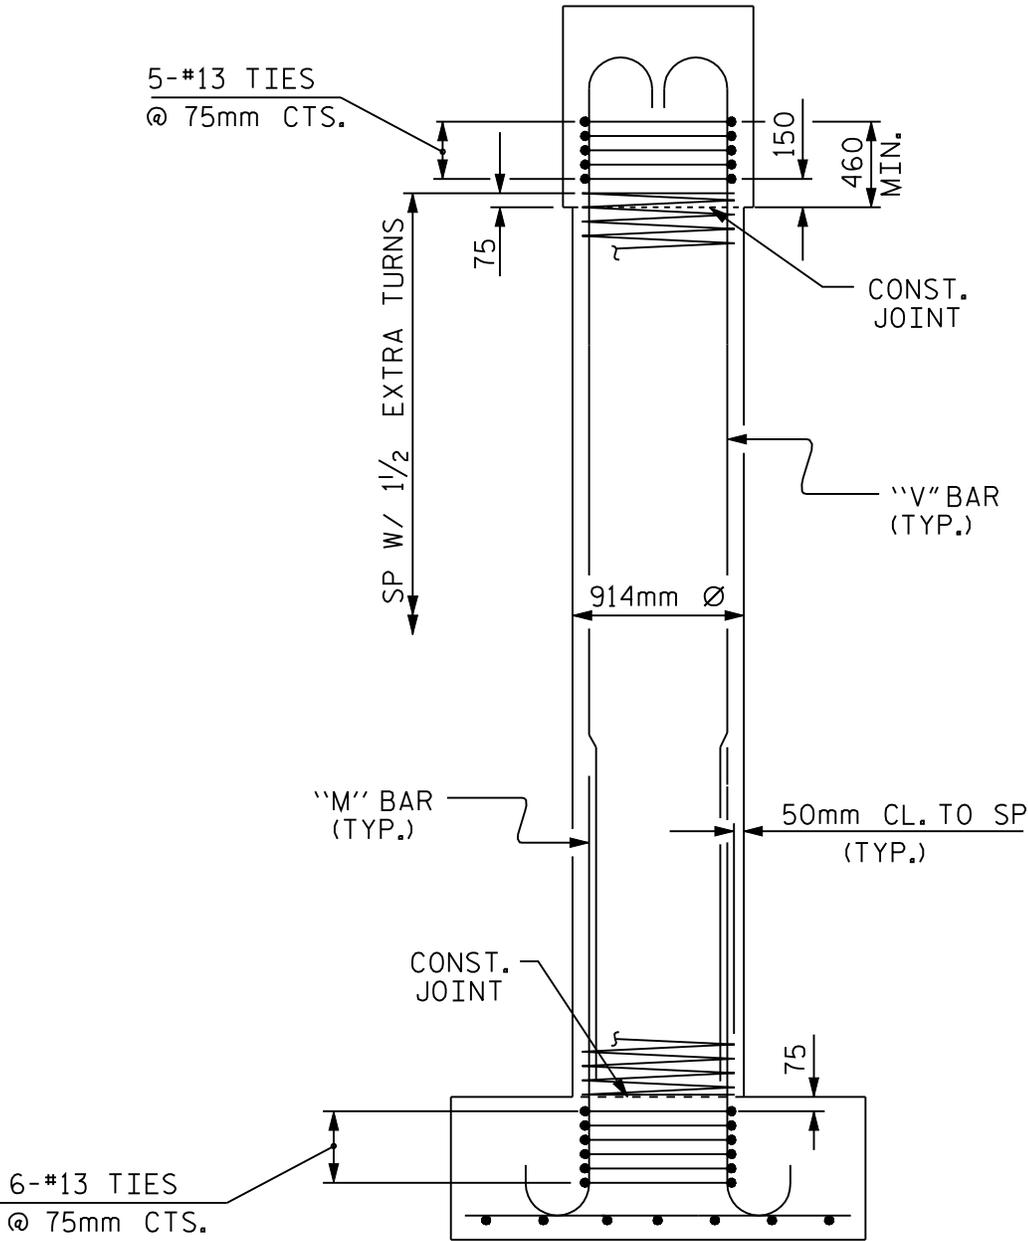

NOTE TO DETAILER:

FOR COLUMNS WITH DIAMETERS GREATER THAN 1220mm USE #16 TIES AT @ 75mm CTS. AND #16 SPIRAL @ 75mm CTS.

TOP MAT OF REINFORCING STEEL IN FOOTING NOT SHOWN FOR CLARITY.

COLUMN CONNECTION DETAILS FOR
SEISMIC PERFORMANCE ZONE 2

FIGURE 7 - 29 M